Rhode Island - Wind Resource Potential
Cumulative Rated Capacity vs. Gross Capacity Factor (CF)

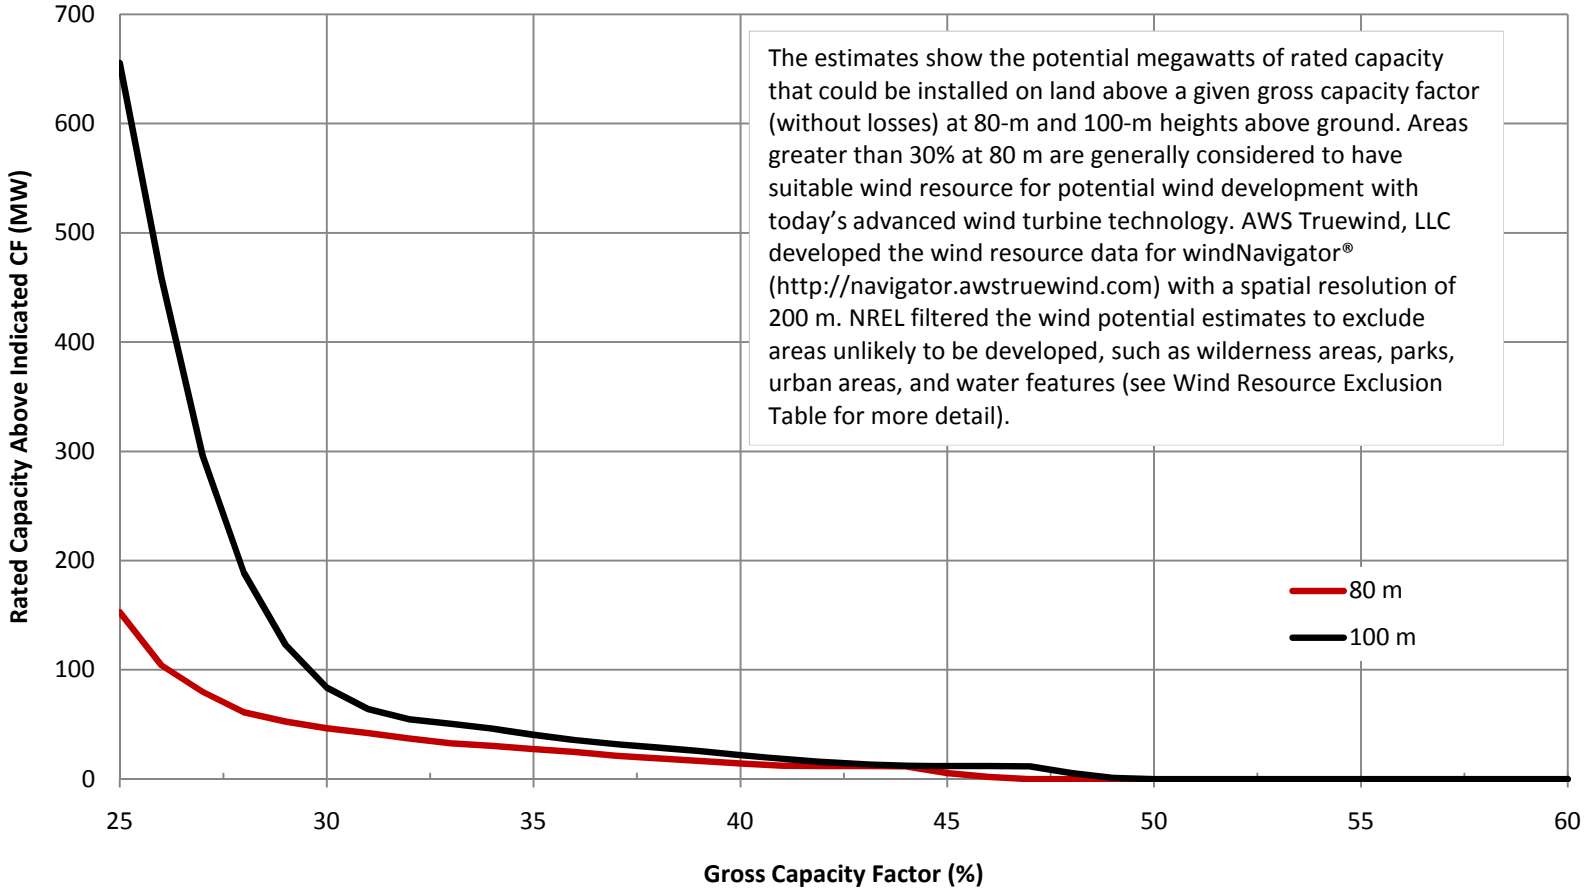

The estimates show the potential megawatts of rated capacity that could be installed on land above a given gross capacity factor (without losses) at 80-m and 100-m heights above ground. Areas greater than 30% at 80 m are generally considered to have suitable wind resource for potential wind development with today's advanced wind turbine technology. AWS Truewind, LLC developed the wind resource data for windNavigator® (http://navigator.awstruewind.com) with a spatial resolution of 200 m. NREL filtered the wind potential estimates to exclude areas unlikely to be developed, such as wilderness areas, parks, urban areas, and water features (see Wind Resource Exclusion Table for more detail).

NREL
NATIONAL RENEWABLE ENERGY LABORATORY

AWS Truepower™
Where science delivers performance.